

# LONGS PEAK WATER DISTRICT


DISTRICT SPECIFICATION DETAIL DRAWING

**NOTE:**

CASING INSULATORS AS MANUFACTURED BY PIPELINE SEAL AND INSULATOR CO., OR APPROVED EQUAL, SPACED AT A MAXIMUM OF 10' ON CENTERS.

**NOTE:**

CASING ENDS SEALS SHALL BE MODEL S AS MANUFACTURED BY PIPELINE SEAL AND INSULATOR CO. OR APPROVED EQUAL.

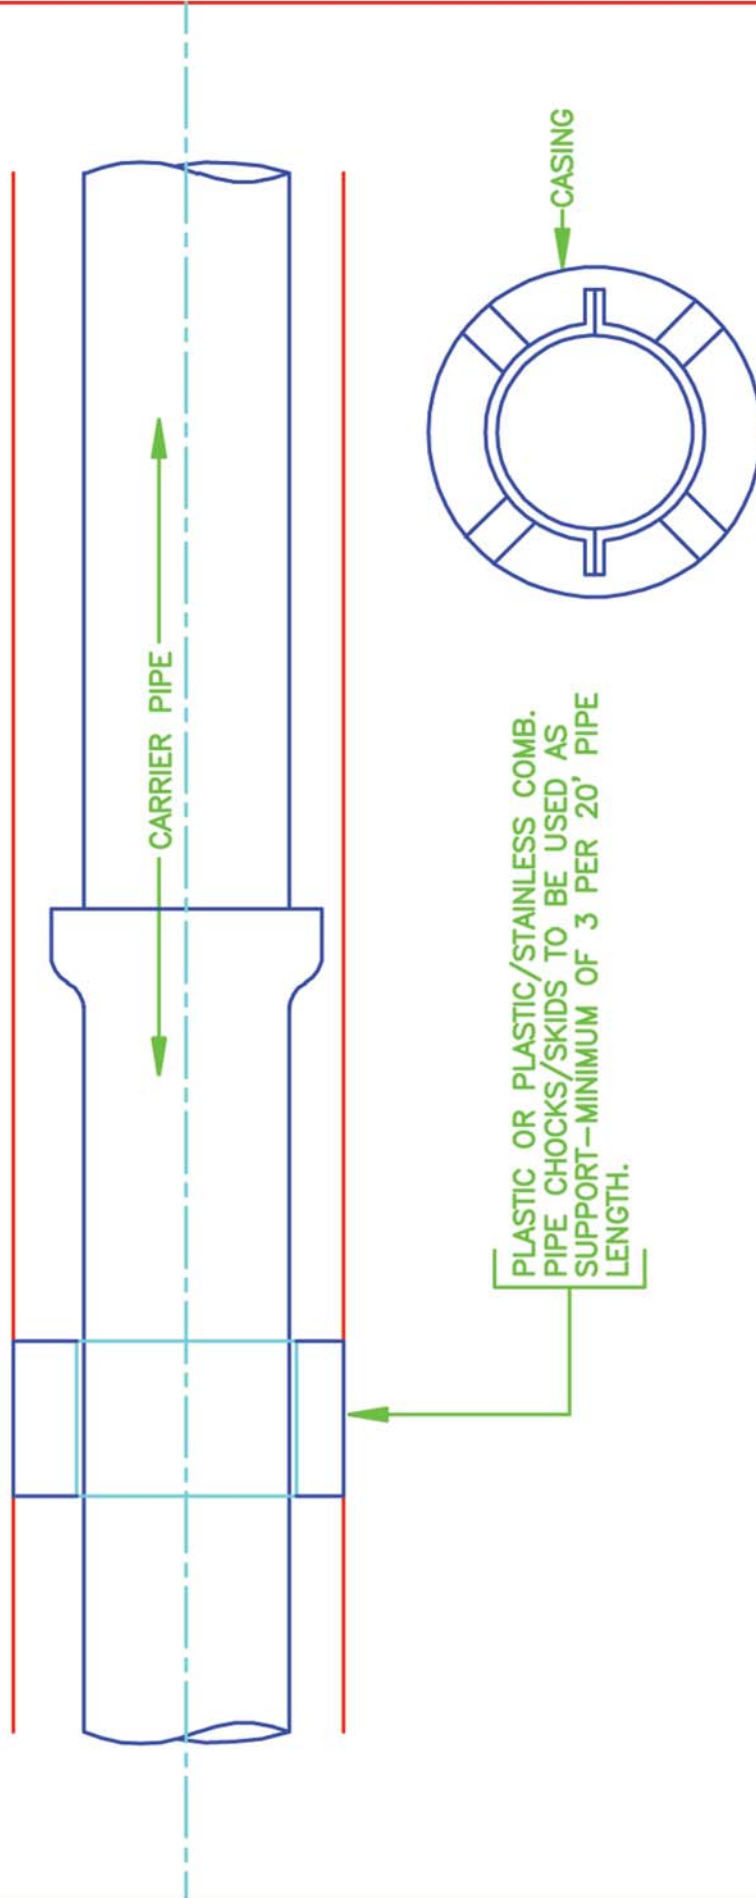

## TYPICAL CASING DETAIL

SCALE: NONE