


LONGS PEAK WATER DISTRICT

DISTRICT SPECIFICATION DETAIL DRAWING

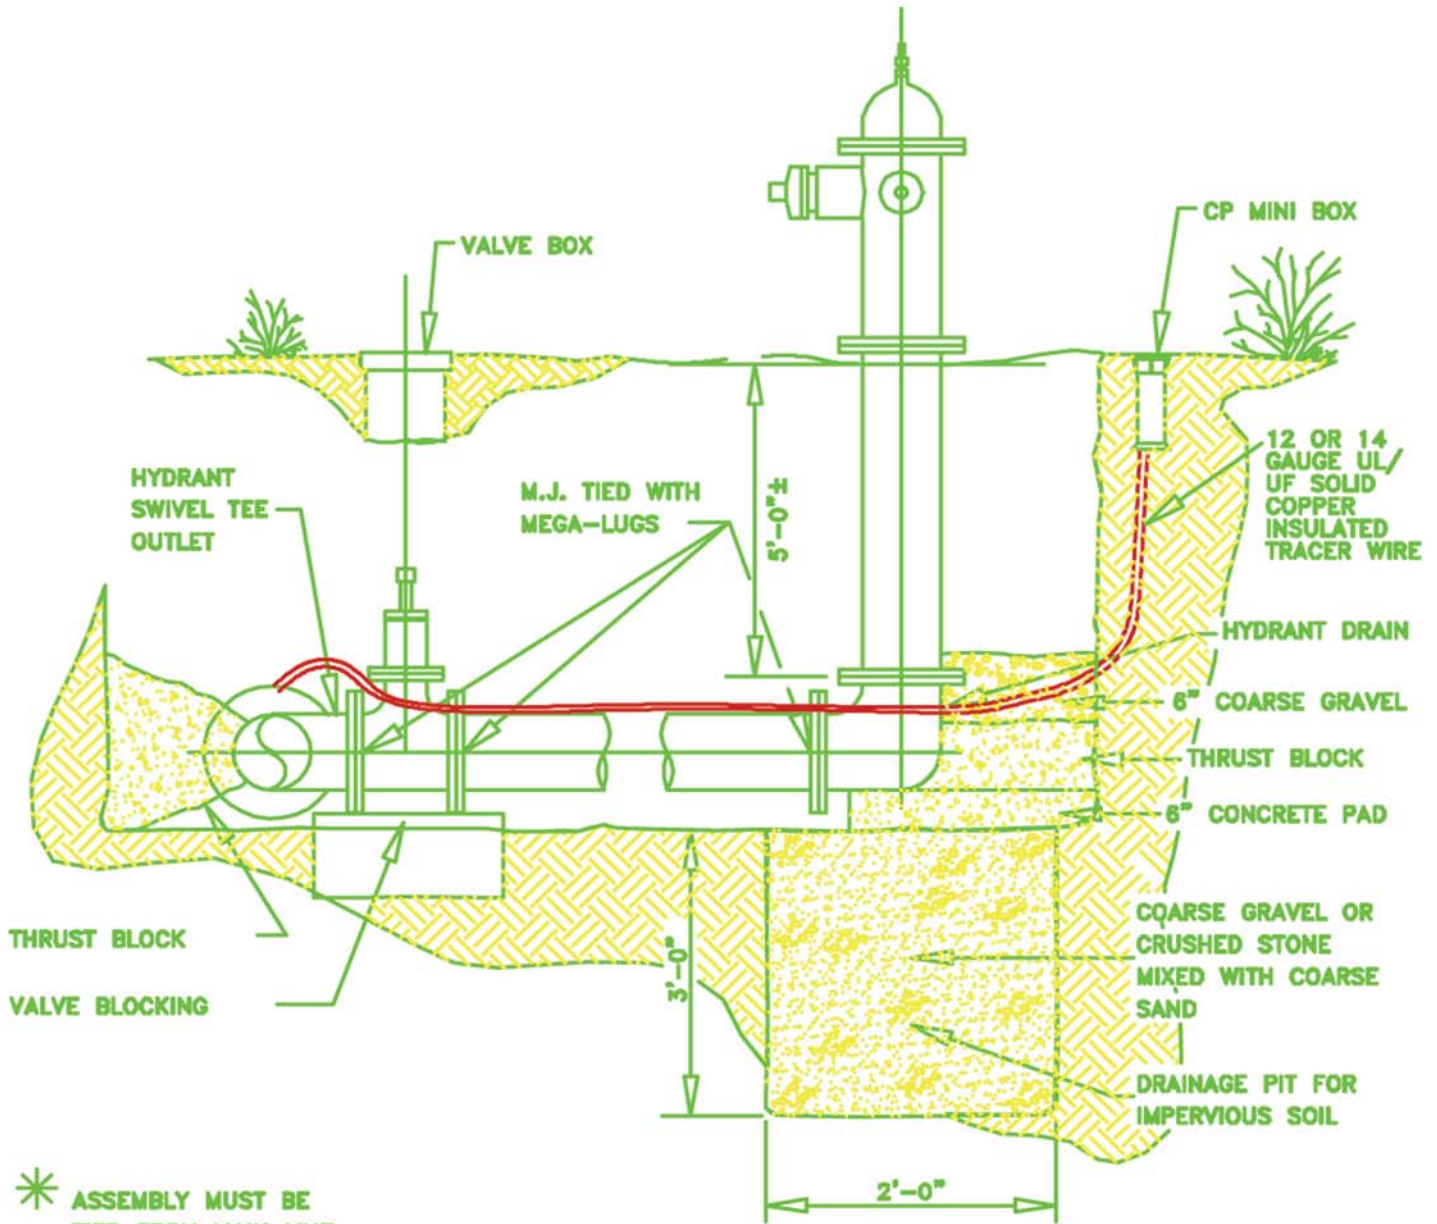

* ASSEMBLY MUST BE TIED FROM MAIN LINE PIPE TO HYDRANT WITH MEGA-LUG TYPE RESTRAINTS.

TYPICAL HYDRANT INSTALLATION