


# LONGS PEAK WATER DISTRICT

## DISTRICT SPECIFICATION DETAIL DRAWING

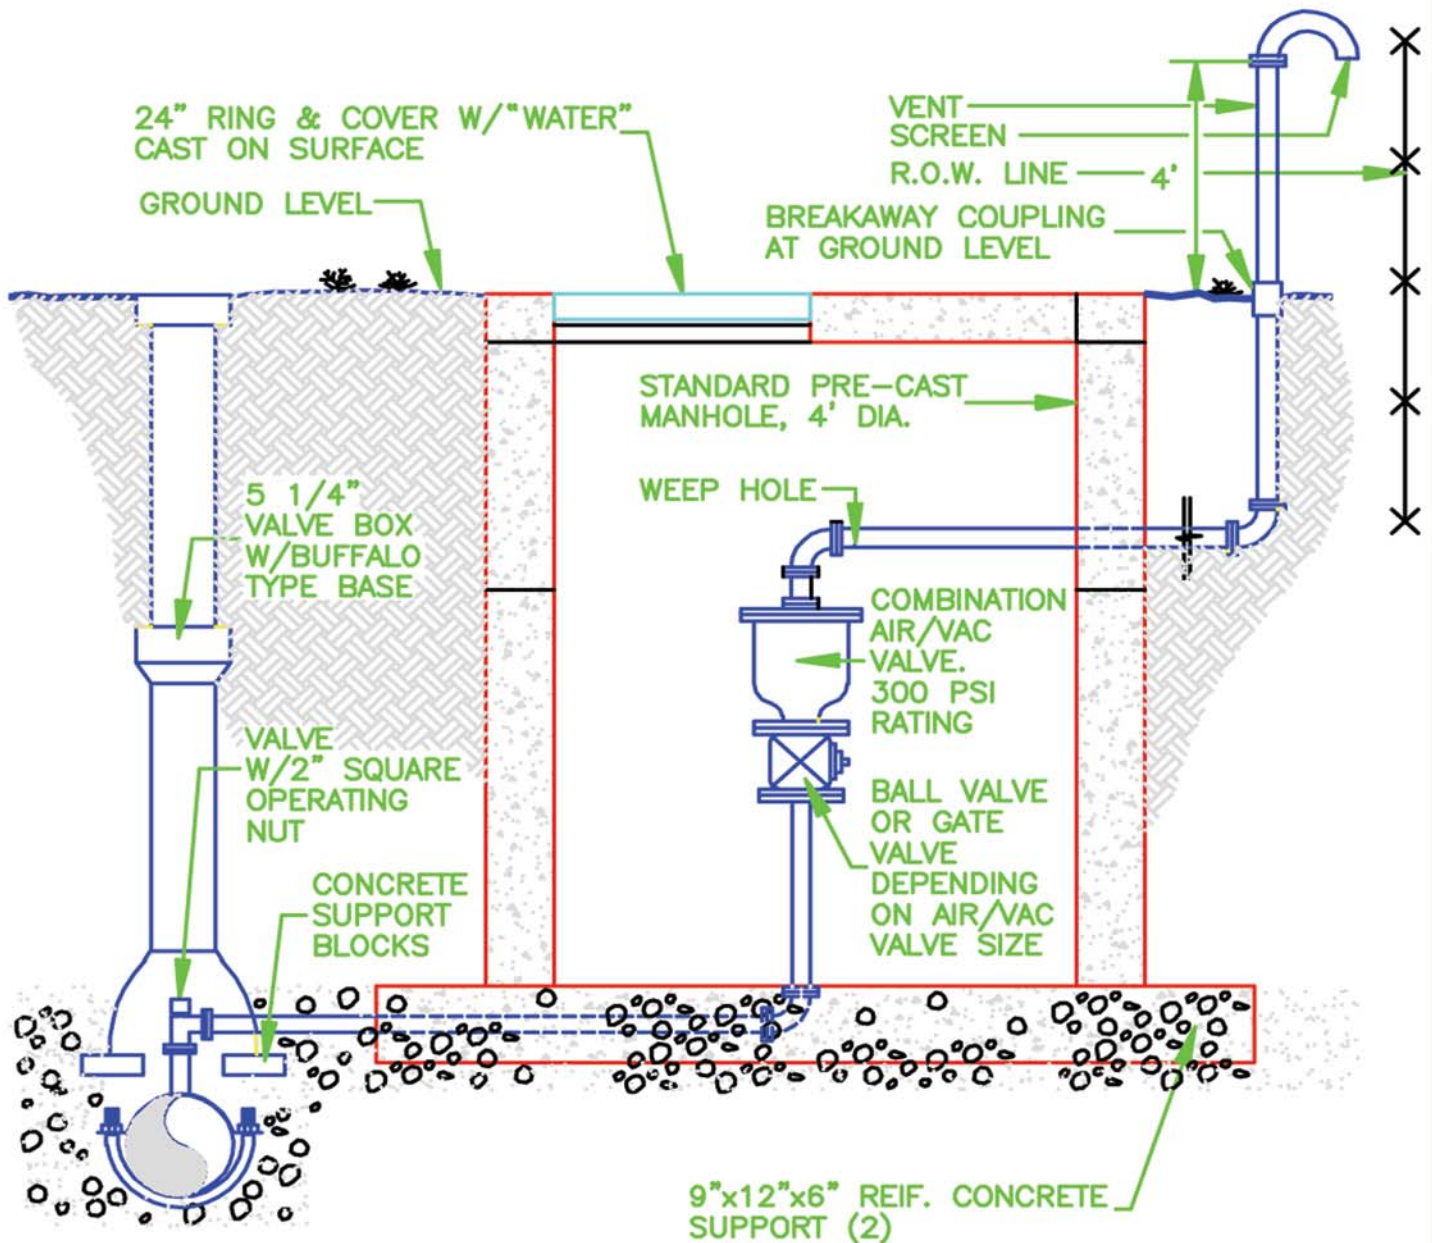

WASHED ROCK —

### ***NOTE:***

VENT PIPE SHALL BE GALVANIZED IRON PIPE.  
ALL OTHER PIPING SHALL BE BRASS, OR IN CERTAIN  
CASES, PVC. VENT PIPE DIAMETER TO BE  
SAME SIZE AS AIR/VAC VALVE SIZE.

## ***TYPICAL AIR/VACUUM VALVE***

(2" AND LARGER)  
SCALE: NONE